


- NOTES:
1. SIDEWALK ELEVATION SHALL BE SET ABOVE INLET ELEVATIONS.
  2. EXISTING UTILITY LINES SHALL BE SLEEVED OR RELOCATED. PROPOSED UTILITY LINES SHALL NOT BE LOCATED IN THE FACILITY.
  3. LONGITUDINAL SLOPE OF PLANTER TO MATCH THE ROAD.
  4. ADDITIONAL TRENCH DRAIN INLETS TO BE ADDED AS NECESSARY TO MEET FLOW SPREAD CRITERIA AND FULL STORMWATER CAPTURE.

PLAN VIEW  
N.T.S.



SECTION A-A  
N.T.S.

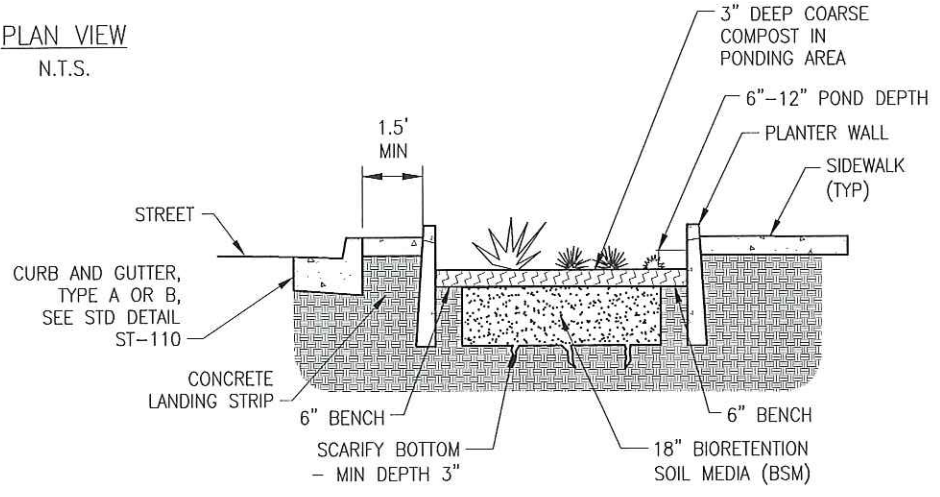

## BIORETENTION PLANTER

STANDARD PLAN:  
**SD-050 LID**  
DATE: JUNE 2017

CITY ENGINEER APPROVAL:  
