



NOTES:

1. SIDEWALK ELEVATION MUST BE SET MIN 1" ABOVE INLET ELEVATIONS.
2. EXISTING UTILITY LINES MUST BE SLEEVED OR RELOCATED. PROPOSED UTILITY LINES MUST NOT BE LOCATED IN THE FACILITY.
3. LONGITUDINAL SLOPE OF CURB EXTENSION TO MATCH THE ROAD.
4. ADDITIONAL SIDE CURB CUT INLETS TO BE ADDED AS NECESSARY TO MEET FLOW SPREAD CRITERIA AND FULL STORMWATER CAPTURE.
5. SLOPE SIDEWALK TO FACILITY AT 2%, AND NOTCH PLANTER WALL (4" NOTCH) EVERY 6' TO ALLOW FLOW ENTRANCE.

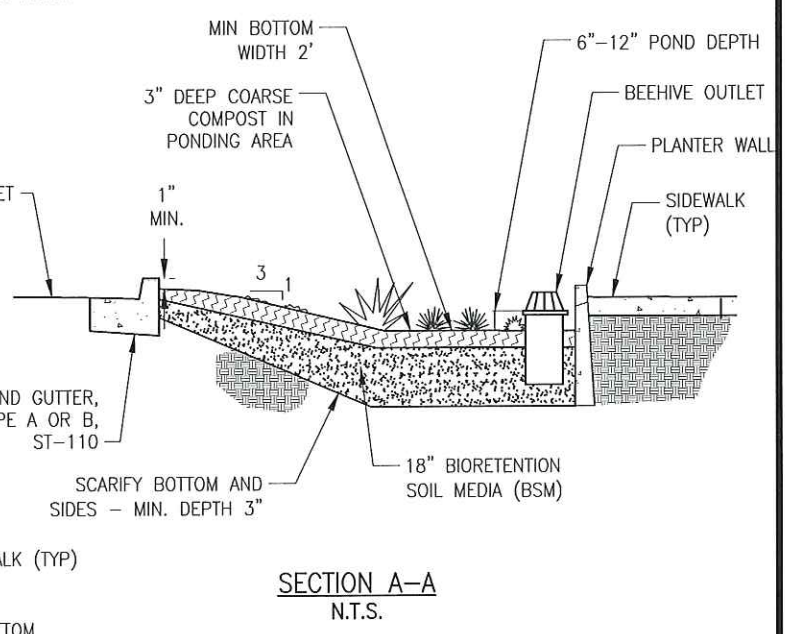

SECTION A-A
N.T.S.

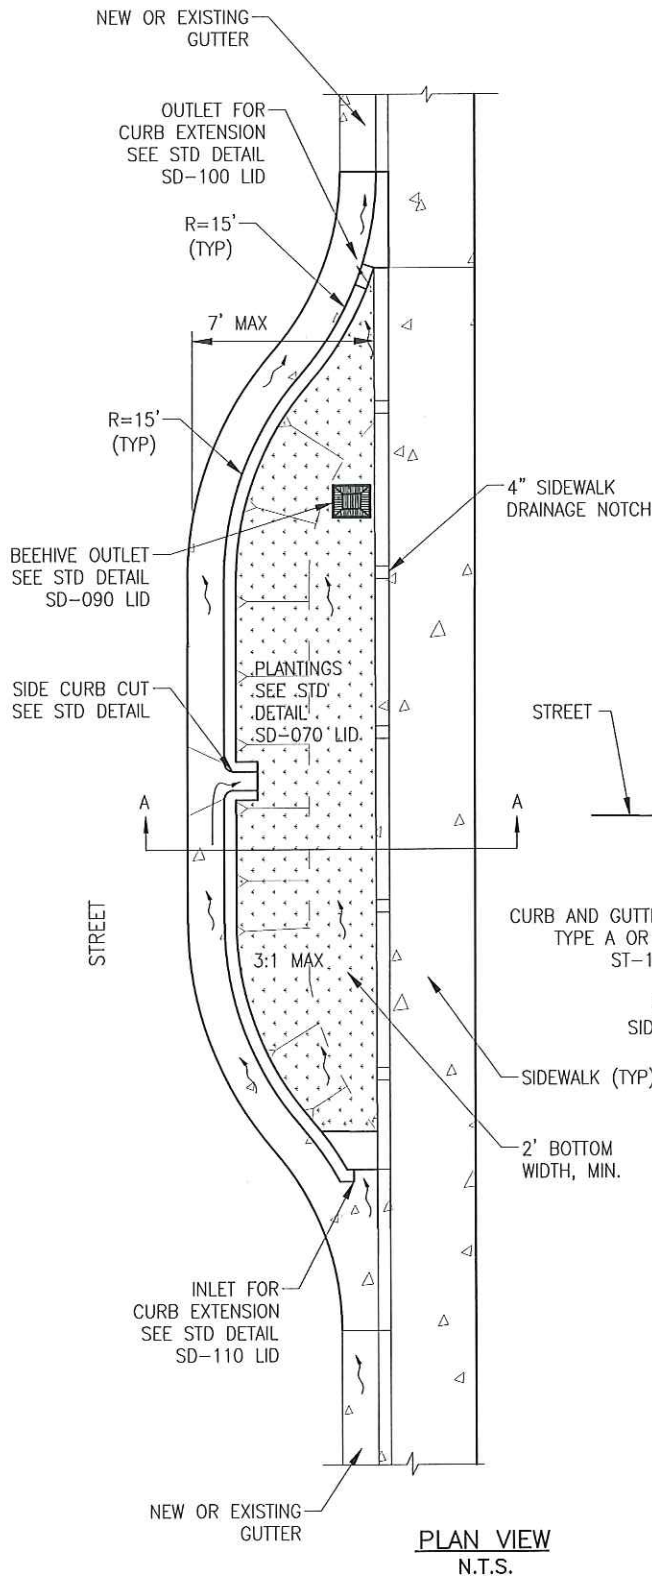

BIORETENTION CURB EXTENSION PLAN

STANDARD PLAN:
SD-060 LID
DATE: JUNE 2017

CITY ENGINEER APPROVAL: