


REMOVE MANHOLE FRAME,
COVER AND CONE AND RETURN
TO OPERATIONS BUILDING

EXISTING FINISH GRADE

REMOVE MANHOLE TO 4'-0"
MINIMUM BELOW FINISH
GRADE. (ALL GRADE RINGS
AND TOP SECTION OF PRECAST
MANHOLE)

FILL MANHOLE SOLID W/LEAN MIX
CONCRETE OR FLOWABLE FILL

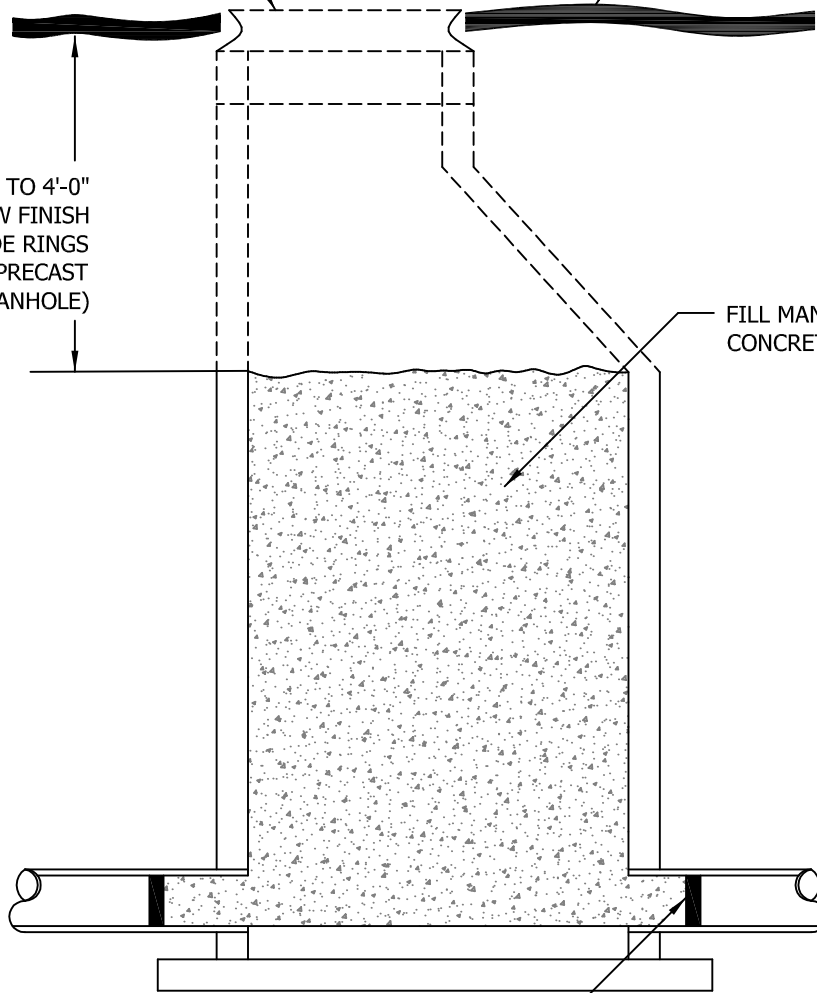

FOR SEWER 15" AND SMALLER DIAMETER, SET
MECHANICAL PLUGS INTO ALL PIPES ENTERING
MANHOLES AS SHOWN. FOR SEWERS 18" AND LARGER
DIAMETER PROVIDE MASONRY BULKHEAD IN LIEU OF
MECHANICAL PLUGS



COMPLETE MANHOLE ABANDONMENT

STANDARD PLAN:
SS - 200

CITY ENGINEER APPROVAL:

Longview: **C.B.**

DATE: **FEB. 2007**

Kelso: **S.Z.**