


**NOTES:**

1. LINK SEALS AROUND ALL PIPE OPENINGS.
2. NOT TO BE LOCATED IN TRAFFIC AREAS OR PARKING LOTS.
3. UTILITY VAULT OR EQUAL.
4. USE DOUBLE RAISE ALUMINUM LW PRODUCTS HHD-1 HYDRAULIC ASSIST LOCKING HATCH (MIN. 36" x 60") (HS20 LOADING) LEAK PROOF GASKET.
5. ALL THUST BLOCKS TO BE CLASS 4000.
6. FIVE (5) PIPE DIAMETERS MIN. PRIOR TO THE STRAINER AND AFTER THE METER.
7. CONTRACTOR OR DEVELOPER WILL SUPPLY METER TO CITY FOR TESTING, METER SIZE TO BE APPROVED BY THE CITY. ALL METERS SHALL READ IN CUBIC FEET.
8. HATCH DRAINS TO BE PLUMBED TO DAYLIGHT.

RSW = RESILIENT SEAT WEDGE  
 NRS = NON-RISING STEM  
 KNOCKOUTS NOT ALLOWED IN VAULTS

① 2" TEST PLUG, 4" BRASS NIPPLE, WITH 2" BALL VALVE WITH PLUG

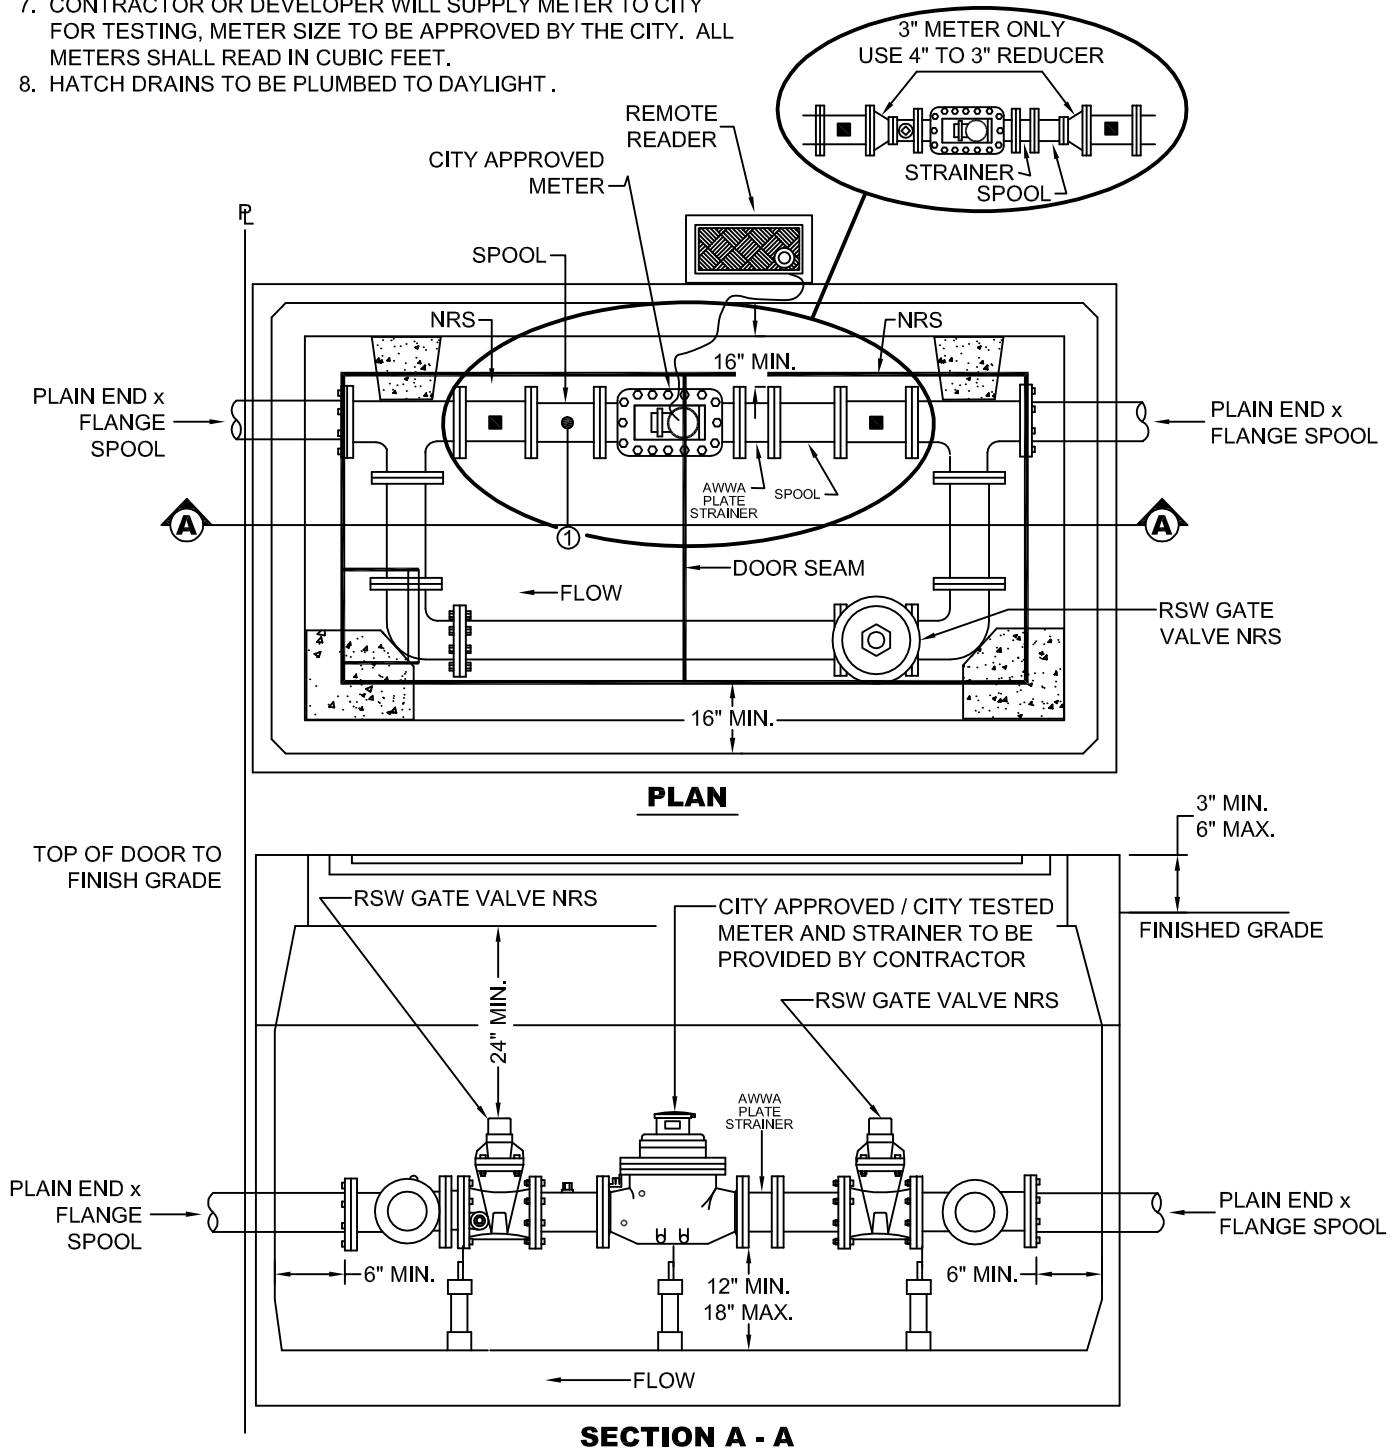

**3" AND LARGER, BELOW GROUND, DOMESTIC METER**

STANDARD PLAN:  
**W - 060**

DATE: **FEB. 2007**

CITY ENGINEER APPROVAL:

Longview: **C.B.**

Kelso: **S.Z.**