


**NOTES:**

1. TAPPING SLEEVE SHALL BE 304 STAINLESS STEEL WITH STAINLESS STEEL FLANGE. JCM OR EQUIVALENT.
2. ALL BOLTS SHALL BE 304 STAINLESS STEEL OR APPROVED EQUAL.
3. TAPPING SLEEVE AND VALVE SHALL BE SUPPORTED BY CONCRETE BLOCKS RESTING ON NATIVE SOIL.
4. TAPPING SLEEVE AND VALVE SHALL BE WRAPPED WITH 10 MIL PLASTIC.
5. CITY MUST WITNESS AIR TEST AND BE PROVIDED WITH TAPPING COUPON.
6. TAPPING SLEEVE EDGE SHALL BE A MINIMUM OF 18 INCHES FROM BELL OR SPIGOT END OF EXISTING PIPE, AND A MINIMUM OF 18 INCHES FROM ANY OTHER TAP OR FITTING.
7. CONTRACTOR SHALL SCHEDULE THE HOT TAP WITH THE CITY 48 HOURS (2 WORKING DAYS) IN ADVANCE.
8. SIZE ON SIZE TAPS ARE NOT PERMITTED.
9. ALL THRUST BLOCKS TO BE CLASS 4000.

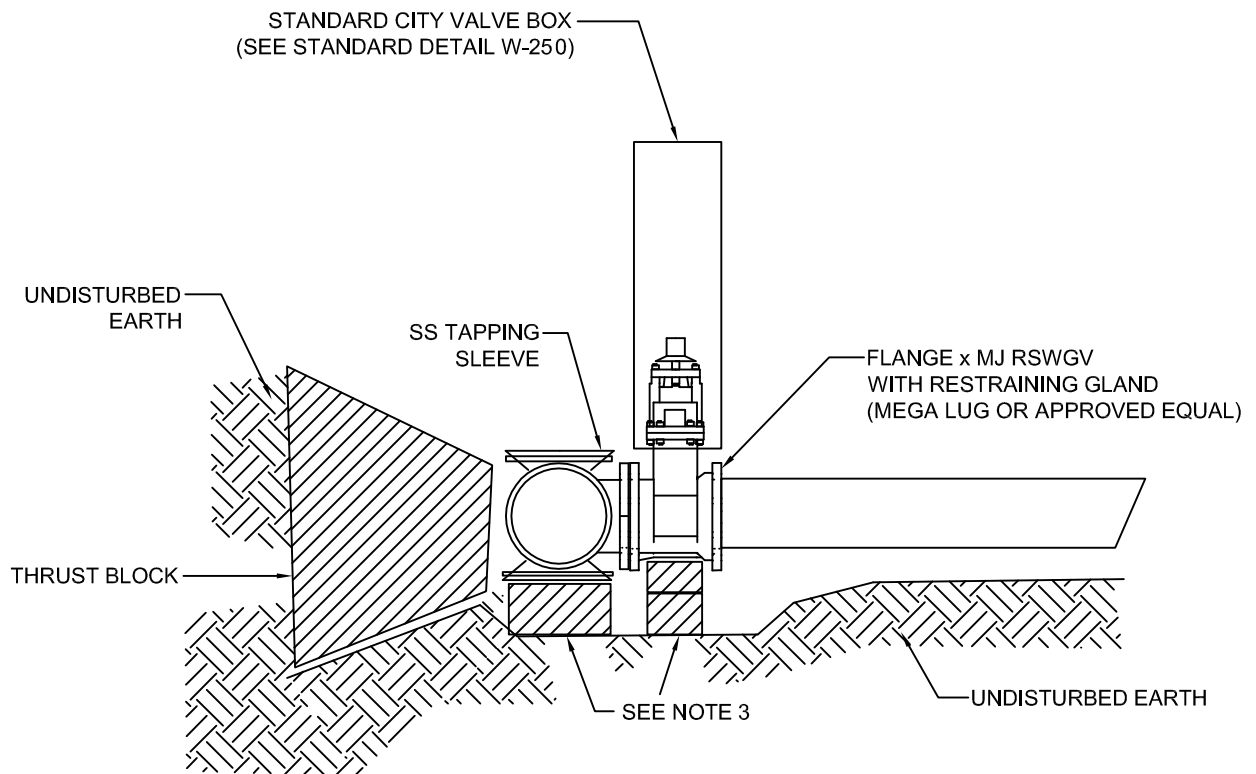

**HOT TAP OF EXISTING WATER MAIN**

STANDARD PLAN: <b>W - 260</b>	CITY ENGINEER APPROVAL:
DATE: <b>FEB. 2007</b>	Longview: <b>C.B.</b>
	Kelso: <b>S.Z.</b>