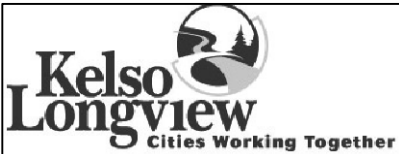


All backfill shall be $\frac{5}{8}$ " minus (CSTC).

Foundation material & Geo grid shall be installed as directed by the City of Longview & to the depth as directed.

All pavement patches shall be 2" plus existing in depth or as directed by the City of Longview.

All pavement shall be full depth sawcut & replaced per the limits as marked by the City of Longview after construction.

	WATER SPECIFICATIONS (5 OF 5)	
	STANDARD PLAN: W - 704	CITY ENGINEER APPROVAL: Longview: C.B.
	DATE: FEB. 2008	Kelso: S.Z.