


**NOTES:**

1. SIDEWALK ELEVATION SHALL BE SET A MINIMUM OF 2" ABOVE INLET ELEVATIONS
2. EXISTING UTILITY LINES SHALL BE SLEEVED OR RELOCATED. PROPOSED UTILITY LINES SHALL NOT BE LOCATED IN THE FACILITY.
3. LONGITUDINAL SLOPE OF PLANTER SHALL MATCH THE ROAD.
4. ADDITIONAL TRENCH DRAIN INLETS TO BE ADDED AS NECESSARY TO MEET FLOW SPREAD CRITERIA AND FULL STORMWATER CAPTURE.
5. INSTALL OPENINGS IN PLANTER WALL EVERY 6' TO ALLOW FLOW ENTRANCE.

BEEHIVE OUTLET  
 6" SIDEWALK DRAINAGE OPENING SPACED EVERY 6'  
 SIDEWALK  
 PLANTER WALL  
 QUARRY SPALLS 8" THICK. MATCH FINISH GRADE OF COMPOST

**PLAN VIEW**  
N.T.S.

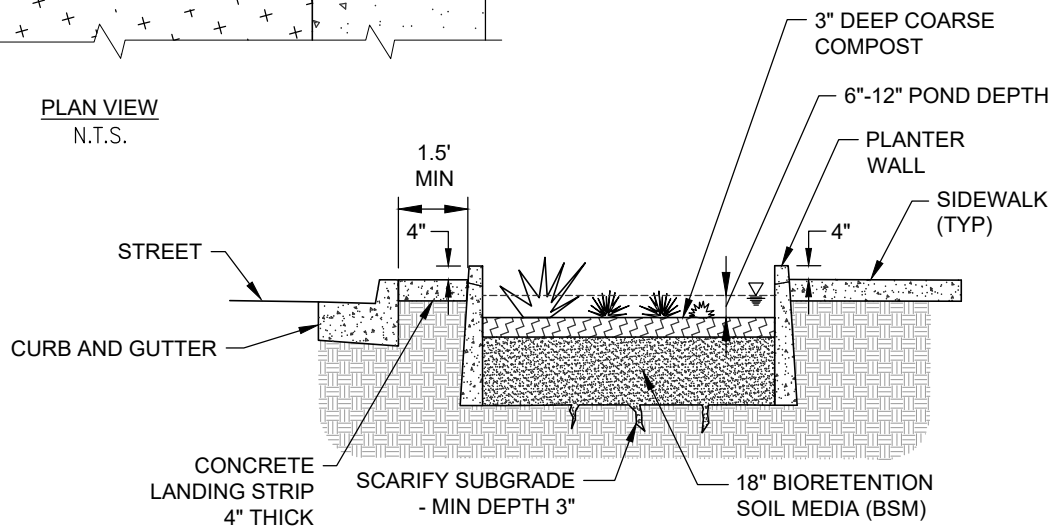

**SECTION A-A**  
N.T.S.



**CITY OF KELSO**  
DEPARTMENT OF  
COMMUNITY DEVELOPMENT  
& ENGINEERING

**BIORETENTION PLANTER**  
CITY ENGINEER APPROVAL: Michael Kardas, P.E.  
x *[Signature]*

STANDARD PLAN NO.  
**KSD-040-21**  
LID  
DATE:  
**MAY 2021**