
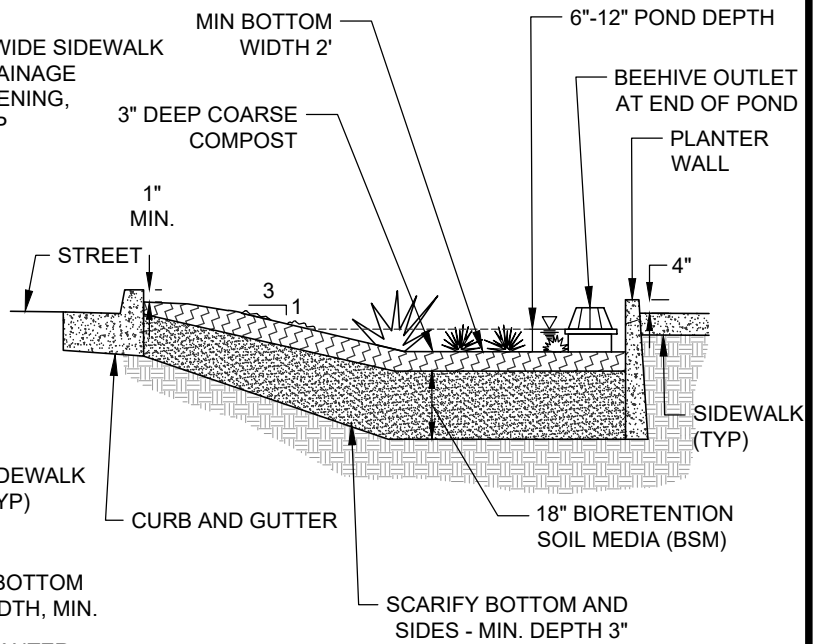


**NOTES:**

1. SIDEWALK ELEVATION MUST BE SET MIN 2" ABOVE INLET ELEVATIONS.
2. EXISTING UTILITY LINES MUST BE SLEEVED OR RELOCATED. PROPOSED UTILITY LINES MUST NOT BE LOCATED IN THE FACILITY.
3. LONGITUDINAL SLOPE OF CURB EXTENSION SHALL MATCH THE ROAD.
4. ADDITIONAL SIDE CURB CUT INLETS TO BE ADDED AS NECESSARY TO MEET FLOW SPREAD CRITERIA AND FULL STORMWATER CAPTURE.
5. INSTALL OPENINGS IN PLANTER WALL EVERY 6' TO ALLOW FLOW ENTRANCE.
6. SET OUTLET ELEVATION 1" BELOW INLET ELEVATION WHILE MAINTAINING GUTTER GRADES. NOTCH CURB AS NECESSARY.

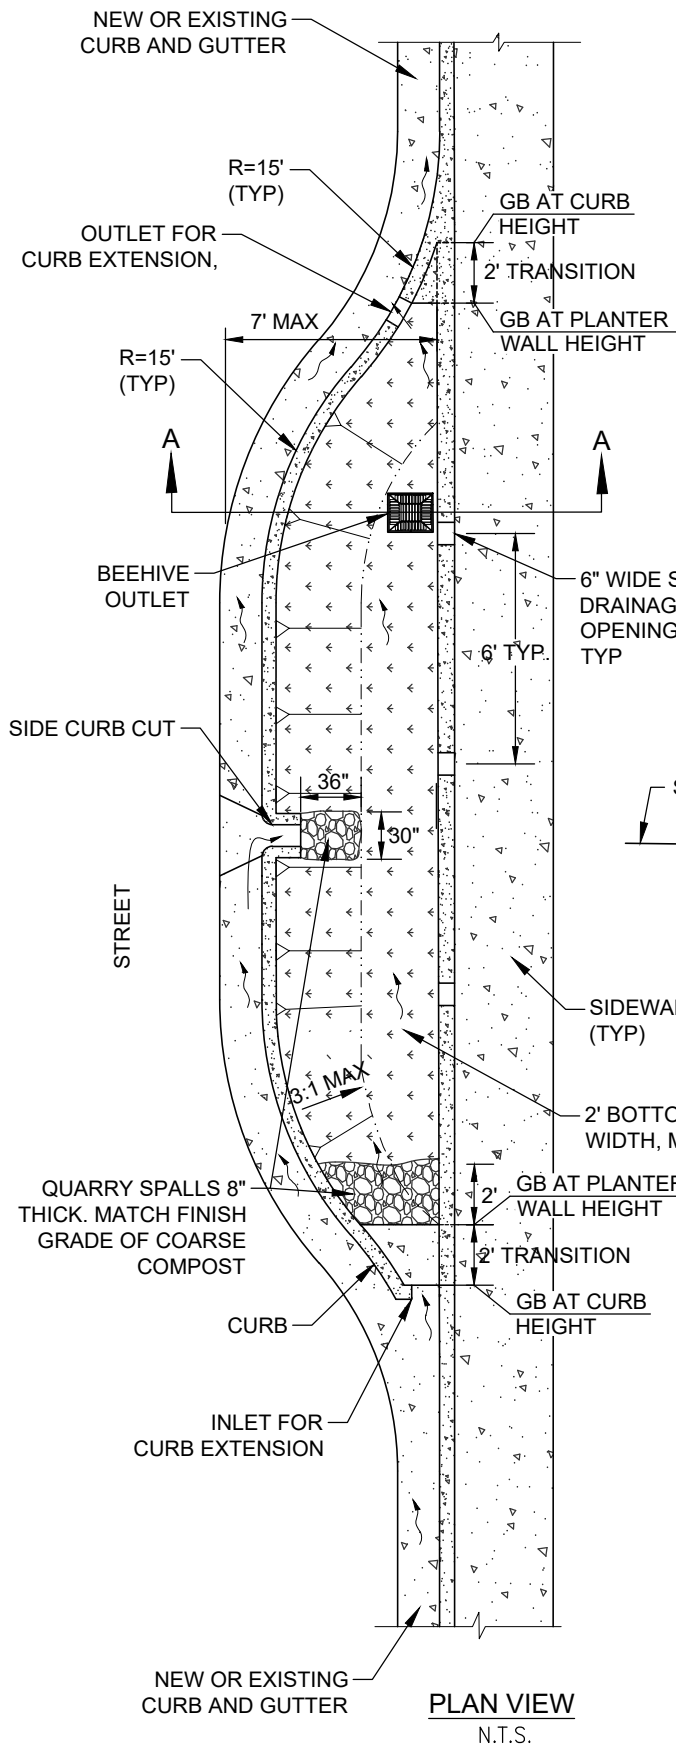

**SECTION A-A**  
N.T.S.

**PLAN VIEW**  
N.T.S.

N.T.S.



**BIORETENTION PLANTER, CURB EXTENSION**

**CITY OF KELSO**  
DEPARTMENT OF  
COMMUNITY DEVELOPMENT  
& ENGINEERING

**CITY ENGINEER APPROVAL: Michael Kardas, P.E.**

x *Michael Kardas*

STANDARD PLAN NO.

**KSD-050-21**  
**LID**

DATE:

**MAY 2021**