
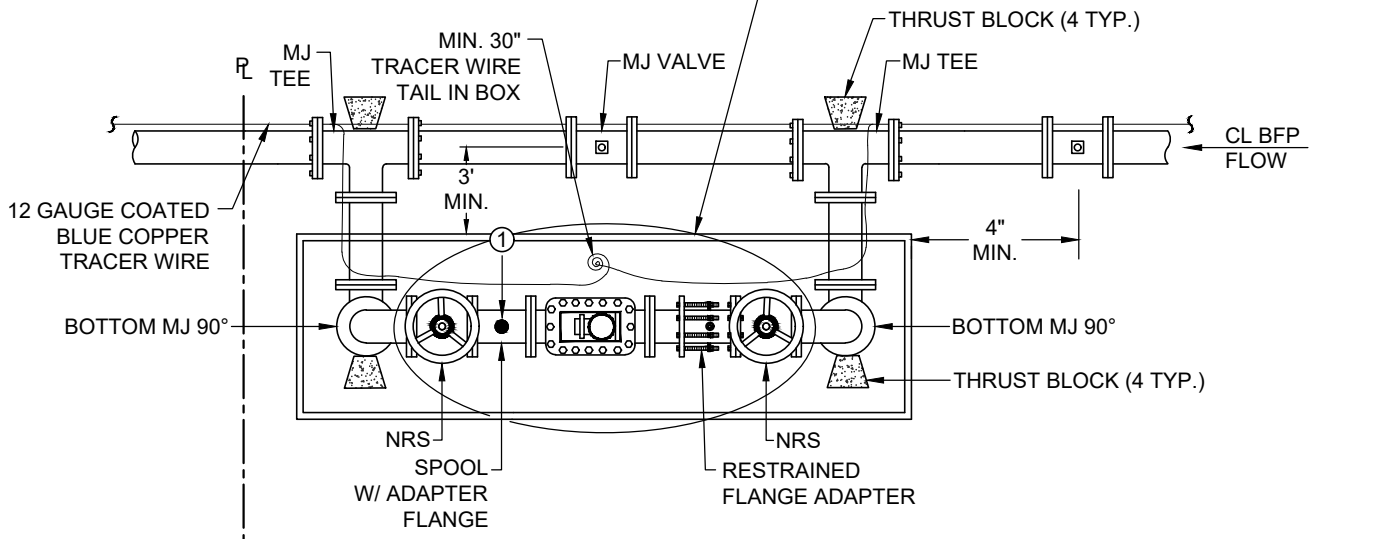



NOTES:

1. INSULATED ENCLOSURE INTERIOR CLEARANCE SHALL BE 12" MINIMUM TO ALL SURFACES AND PER MANUFACTURERS SPECIFICATIONS.
3. 5" PIPE DIAMETER MIN. PRIOR TO THE STRAINER AND AFTER THE METER.
4. CITY SHALL PROVIDE WATER METER WITH STRAINER.
5. RESTRAINED FLANGE ADAPTER SHALL BE MEGAFLANGE - SERIES 2100 OR APPROVED EQUAL.

① 2" TEST PLUG, 4" BRASS NIPPLE, WITH 2" BALL VALVE AND PLUG WITH ROMAC SST SADDLE.

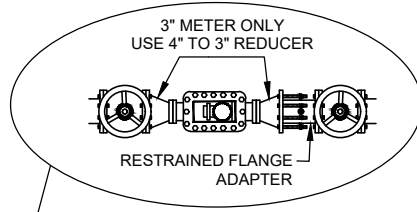

PLAN

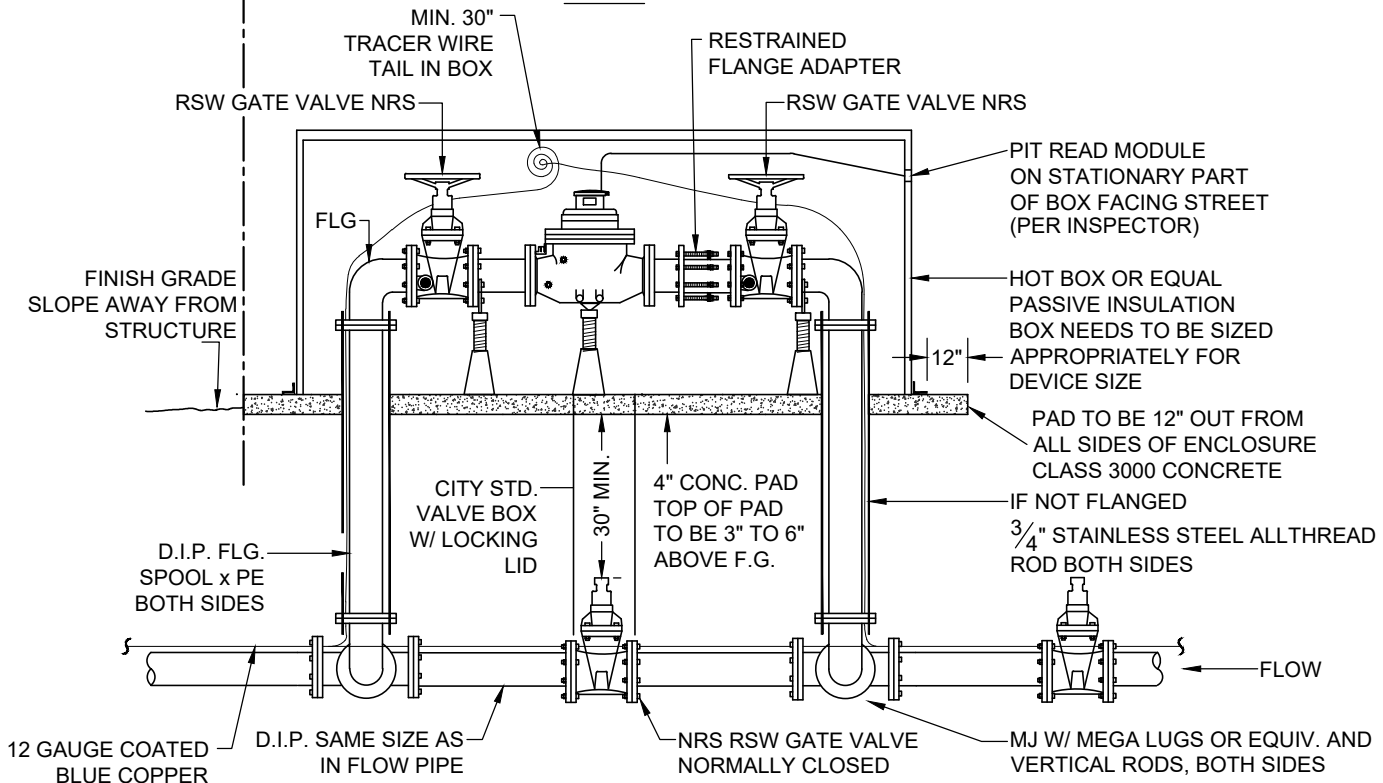

ELEVATION

N.T.S.

	WATER METER ASSEMBLY AND VAULT		STANDARD PLAN NO.
	3" & LARGER, ABOVE GROUND		KW-050-21
CITY OF KELSO DEPARTMENT OF COMMUNITY DEVELOPMENT & ENGINEERING	CITY ENGINEER APPROVAL: Michael Kardas, P.E.		DATE: MAY 2021
			