


- BLOWOFFS SHALL BE INSTALLED 1' FROM THE END OF THE MAIN.
- COVER FOR CONCRETE BLOWOFF ENCLOSURE SHALL HAVE TITLE "WATER" 2.
- MIN. 6" CSTC UNDER BLOWOFF PIPE AND MANHOLE

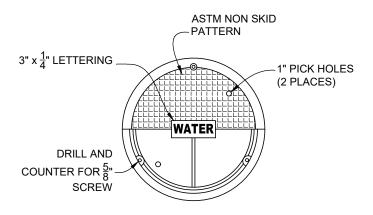

DETAIL A - MANHOLE COVER

N.T.S.

2" BLOWOFF ASSEMBLY

CITY ENGINEER APPROVAL: Michael Kardas, P.E.

KW-090-21

STANDARD PLAN NO.

MAY 2021

CITY OF KELSO

DEPARTMENT OF COMMUNITY DEVELOPMENT & ENGINEERING