

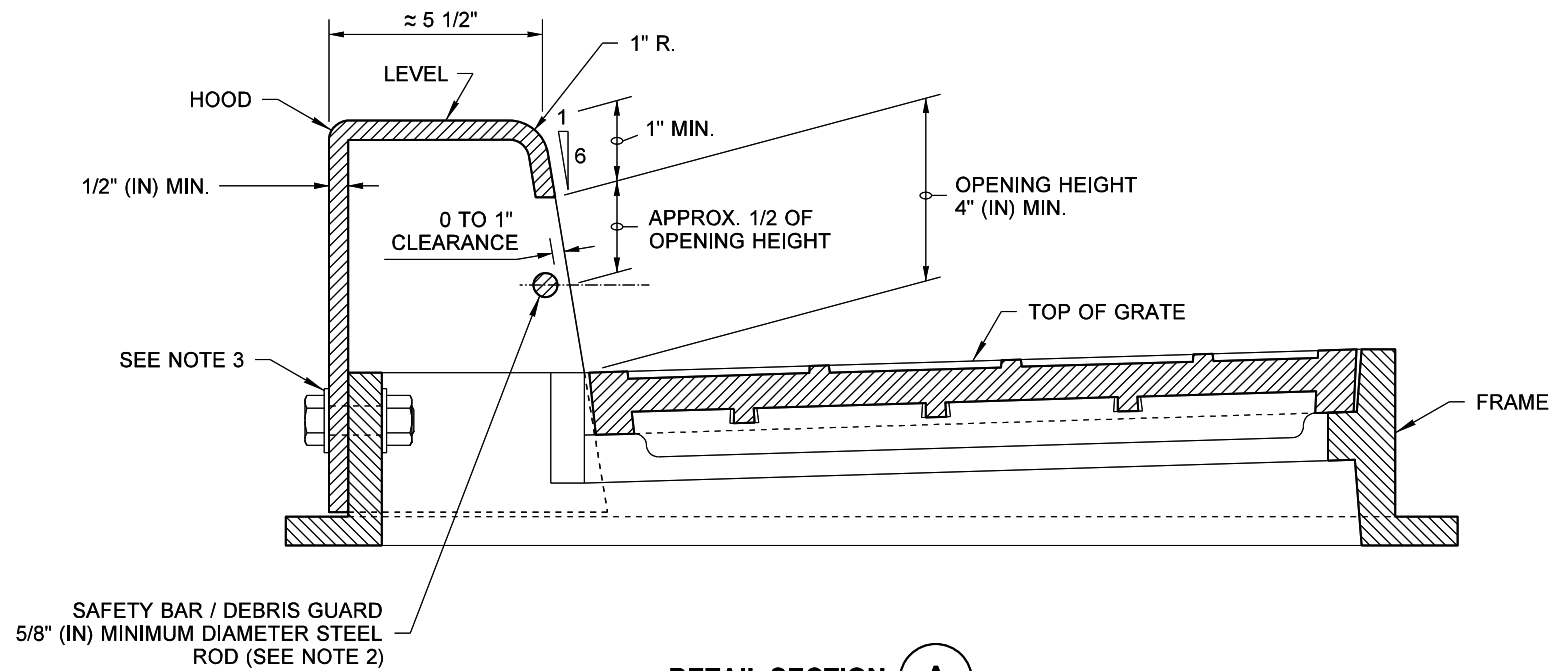
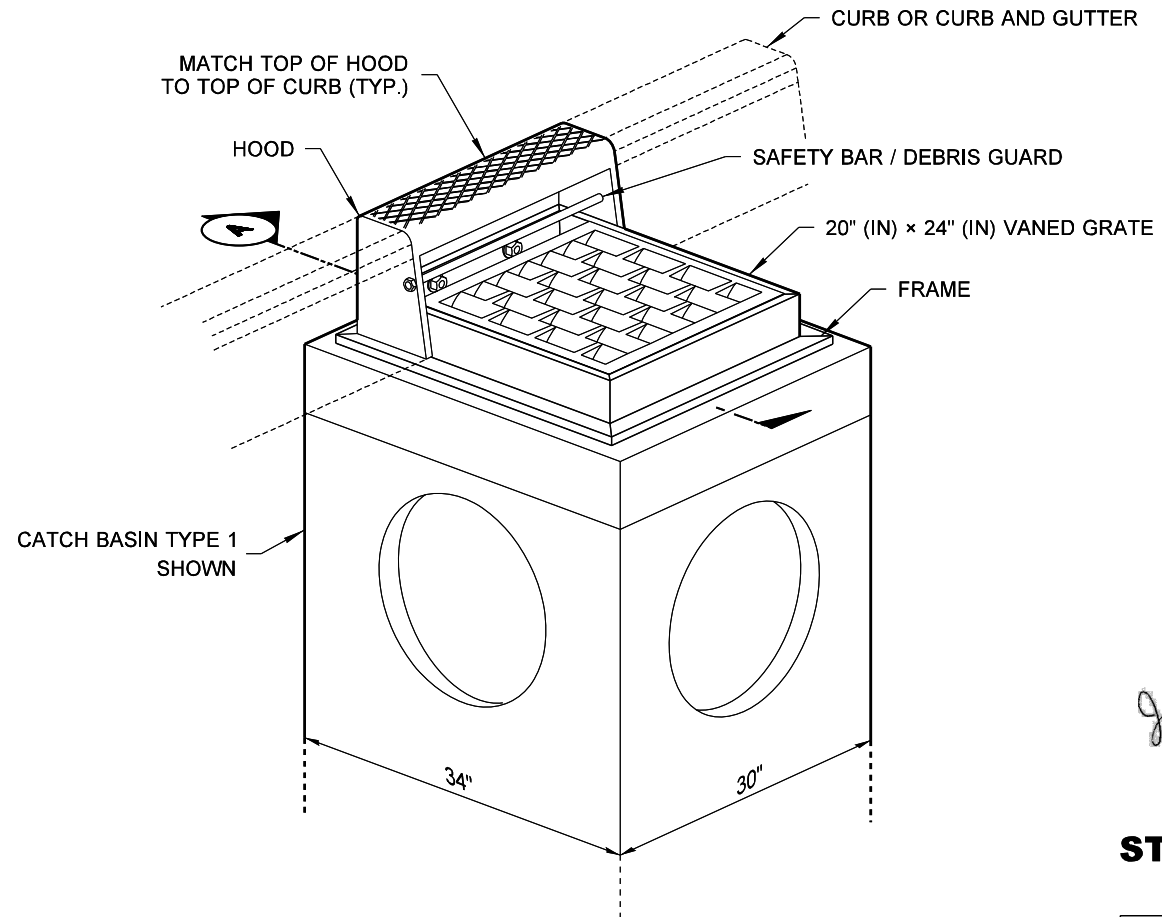


DRAWN BY: FERN LIDDELL

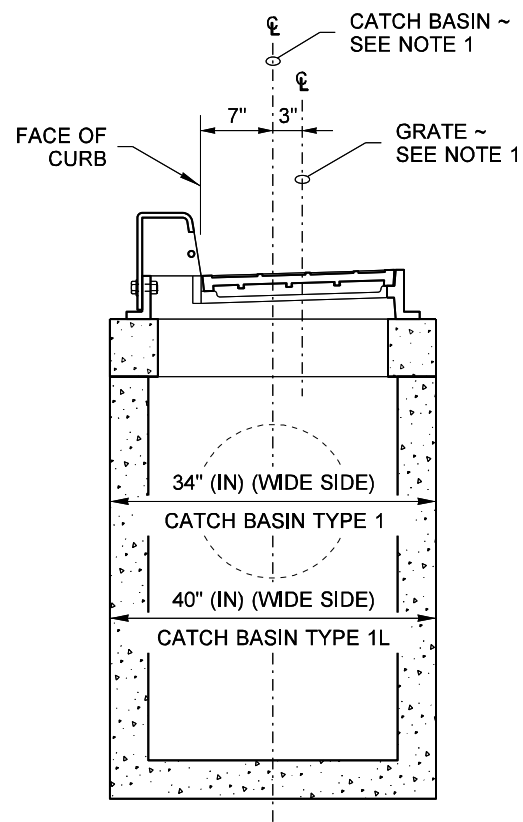

## NOTES

1. This inlet requires the precast catch basin unit to be rotated 90 degrees so that the narrow side is parallel to the curb line. When calculating offsets from curb to centerline (CL) of the precast catch basin, please note that the CL of the grate is not the CL of the precast catch basin. See **Section A**.
2. The dimensions of the frame and hood may vary slightly among different manufacturers. The Frame may have cast features intended to support a debris guard. Hood units may be mounted inside or outside of the frame. The methods for fastening the safety bar / debris guard rod to the hood may vary. The hood may include casting lugs. The top of the hood may be cast with a pattern.
3. Attach the hood to the frame with two 3/4" (in) x 2" (in) hex head bolts, nuts, and oversize washers. The washers shall have diameters adequate to ensure full bearing across the slots.
4. Bolt-down capability is required on all frames, grates and covers, unless specified otherwise in the Contract. Provide two holes in the frame that are vertically aligned with the grate or cover slots. The frame shall accept the 304 Stainless Steel (S.S.) 5/8" (in) - 11 NC x 2" (in) allen head cap screw by being tapped, or other approved mechanism. Location of bolt-down holes varies by manufacturer. See **BOLT-DOWN DETAIL, Standard Plan B-30.10**.
5. Only ductile iron Vaned Grates shall be used. See **Standard Plans B-30.30 and B-30.40** for grate details. Refer to **Standard Specification Section 9-05.15(2)** for additional requirements.
6. This plan is intended to show the installation details of a manufactured product. This plan is not intended to show the specific details necessary to fabricate the castings depicted in this drawing.

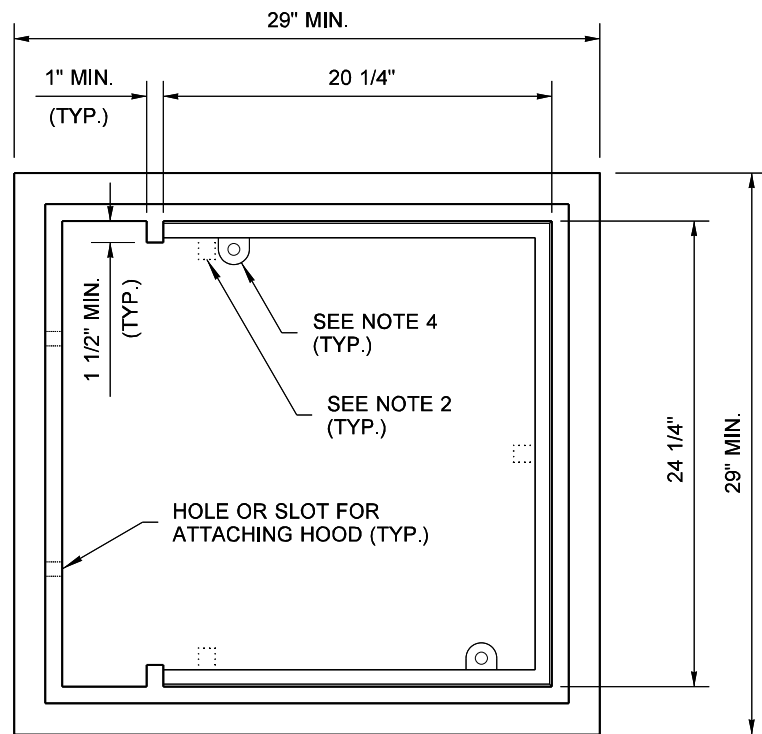

Heilman, Julie  
Feb 20 2018 12:51 PM  
cosign

## COMBINATION INLET

### STANDARD PLAN B-25.20-02

SHEET 1 OF 1 SHEET

APPROVED FOR PUBLICATION

Carpenter, Jeff  
Feb 27 2018 7:43 AM  
cosign

STATE DESIGN ENGINEER

Washington State Department of Transportation

# SUPPLEMENTAL TO STANDARD PLAN B-25.20-02

## **Modify the Standard Plan as follows:**

### Notes:

1. Tracer wire shall be installed along the top of all pipe entering the structure, then up the wall and attached with a 3' long coil of slack at the top inside of the structure.