





DRAWN BY: LISA CYFORD

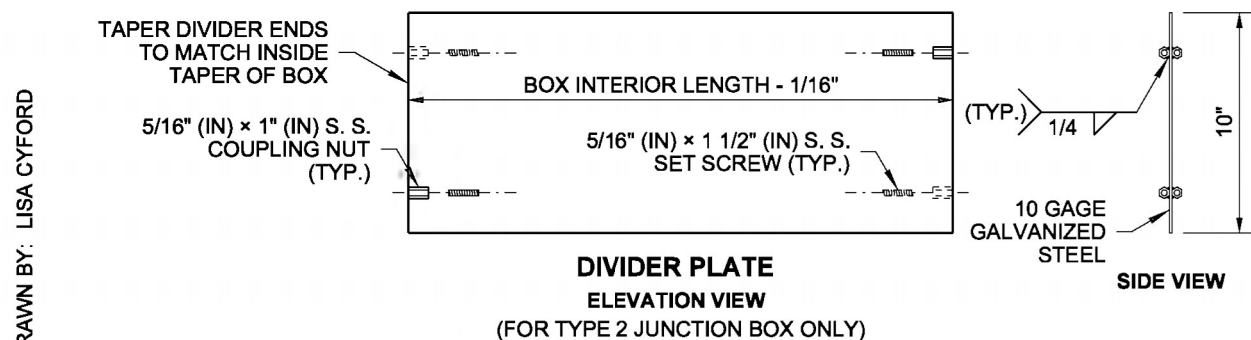




JUNCTION BOX DIMENSION TABLE			
MARK	ITEM	BOX TYPE	
		TYPE 1	TYPE 2
A	OUTSIDE LENGTH OF JUNCTION BOX	22"	33"
B	OUTSIDE WIDTH OF JUNCTION BOX	17"	22 1/2"
C	INSIDE LENGTH OF JUNCTION BOX	18" ~ 19"	28" ~ 29"
D	INSIDE WIDTH OF JUNCTION BOX	13" ~ 14"	17" ~ 18"
E	LID LENGTH	17 5/8"	28 5/8"
F	LID WIDTH	12 5/8"	18 1/8"
	CAPACITY ~ CONDUIT DIAMETER	6"	12"

NOTES

1. All box dimensions are approximate. Exact configurations vary among manufacturers.
 2. Minimum lid thickness shown. Junction Boxes installed in sidewalks, walkways, and shared-use paths shall have a slip-resistant coating on the lid and lip cover plate, and shall be installed with the surface flush with and matched to the grade of the sidewalk, walkway, or shared-use path. The non-slip lid shall be identified with permanent markings on the underside, indicating the type of surface treatment (see Contract Documents for details) and the year of manufacture. The permanent marking shall be 1/8" (in) line thickness formed with a mild steel weld bead and shall be placed prior to hot-dip galvanizing.
 3. Lid support members shall be 3/16" (in) minimum thick steel C, L, or T shape, welded to the frame.
 4. A 1/4-20 NC x 3/4" (in) stainless steel ground stud shall be welded to the bottom of the lid; include (2) stainless steel nuts and (2) stainless steel flat washers.
 5. Bolts and nuts shall be liberally coated with anti-seize compound.
 6. Equipment Bonding Jumper shall be # 8 AWG min. x 4' (ft) of tinned braided copper.
- System Identification letters shall be 1/8" (in) line thickness formed with a mild steel weld bead. See Marking detail. Grind off diamond pattern before forming letters. For System Identification details, see **Standard Specification 9-29.2(4)**.
- When required in the Contract, provide a 10" (in) x 27 1/2" (in), 10 gage divider plate, complete, with markers, in each Type 2 Junction Box where specified.
- When required in Contract, provide a 12" (in) deep extension for each Type 2 Junction Box where specified. See the **Standard Specifications** for alternative reinforcement and class of concrete.
- Welded Anchor Shear Studs must be welded to the Steel Cover Lip Plate and wire tied in two places to the vertical Welded Wire Fabric when in contact with each other. Wire tie all other Headed Anchor Shear Studs to the horizontal Welded Wire Fabric.
- The Bolt Down Attachment Tab provides a method of retrofitting by using a mechanical process in lieu of welding. Attachment Tab shown depicts a typical component arrangement; actual configurations of components will vary among manufacturers. See approved manufacturers' shop drawings for specifics.
- Unless otherwise noted in the plans or approved by the Engineer, Junction Boxes, Cable Vaults, and Pull Boxes shall not be placed within the sidewalks, walkways, shared use paths, traveled ways or paved shoulders. All Junction Boxes, Cable Vaults, and Pull Boxes placed within the traveled way or paved shoulders shall be Heavy-Duty.
- The clearance between the top of the conduit and the bottom of the Junction Box lid shall be 6" (in) min. to 8" (in) max. for final grade of new construction only. See **Standard Specification 8-20.3(5)**. Where adjustments are to be made to existing Junction Boxes, or for interim construction stages during the contract, the clearance shall be from 6" (in) min. to 10" (in) max. See **Standard Specification 8-20.3(6)**.

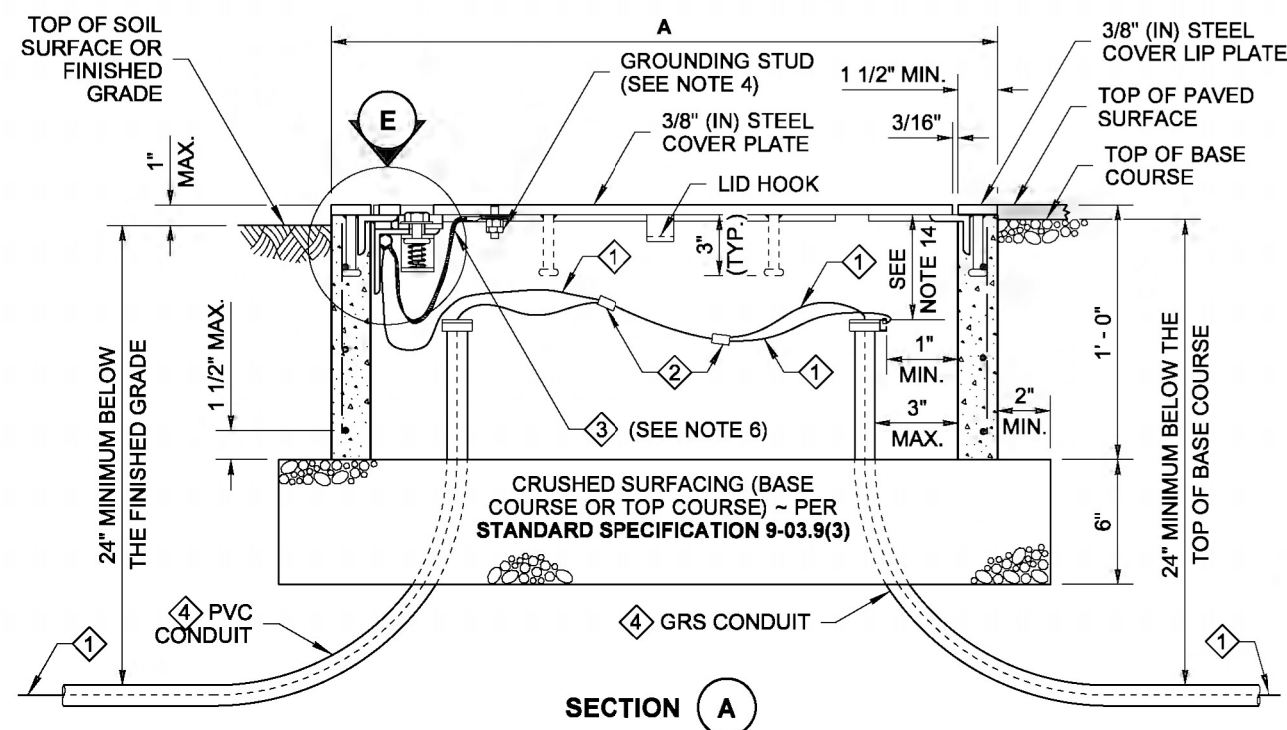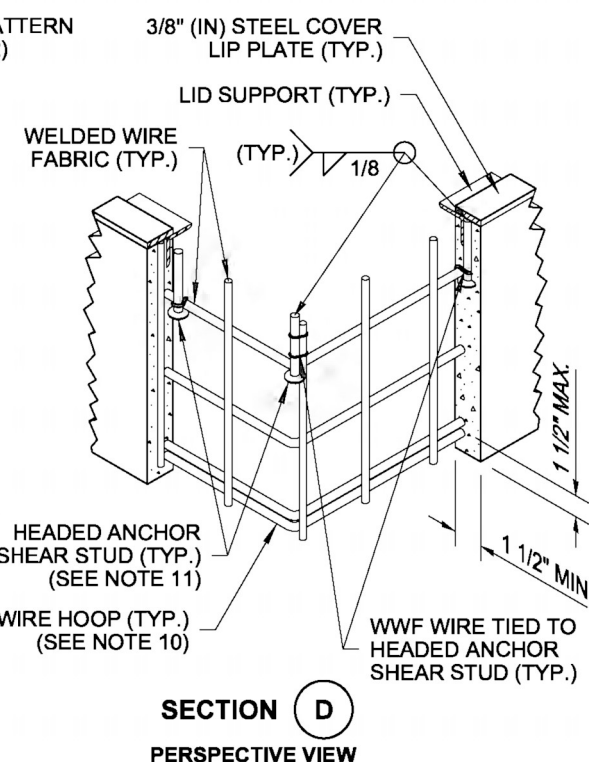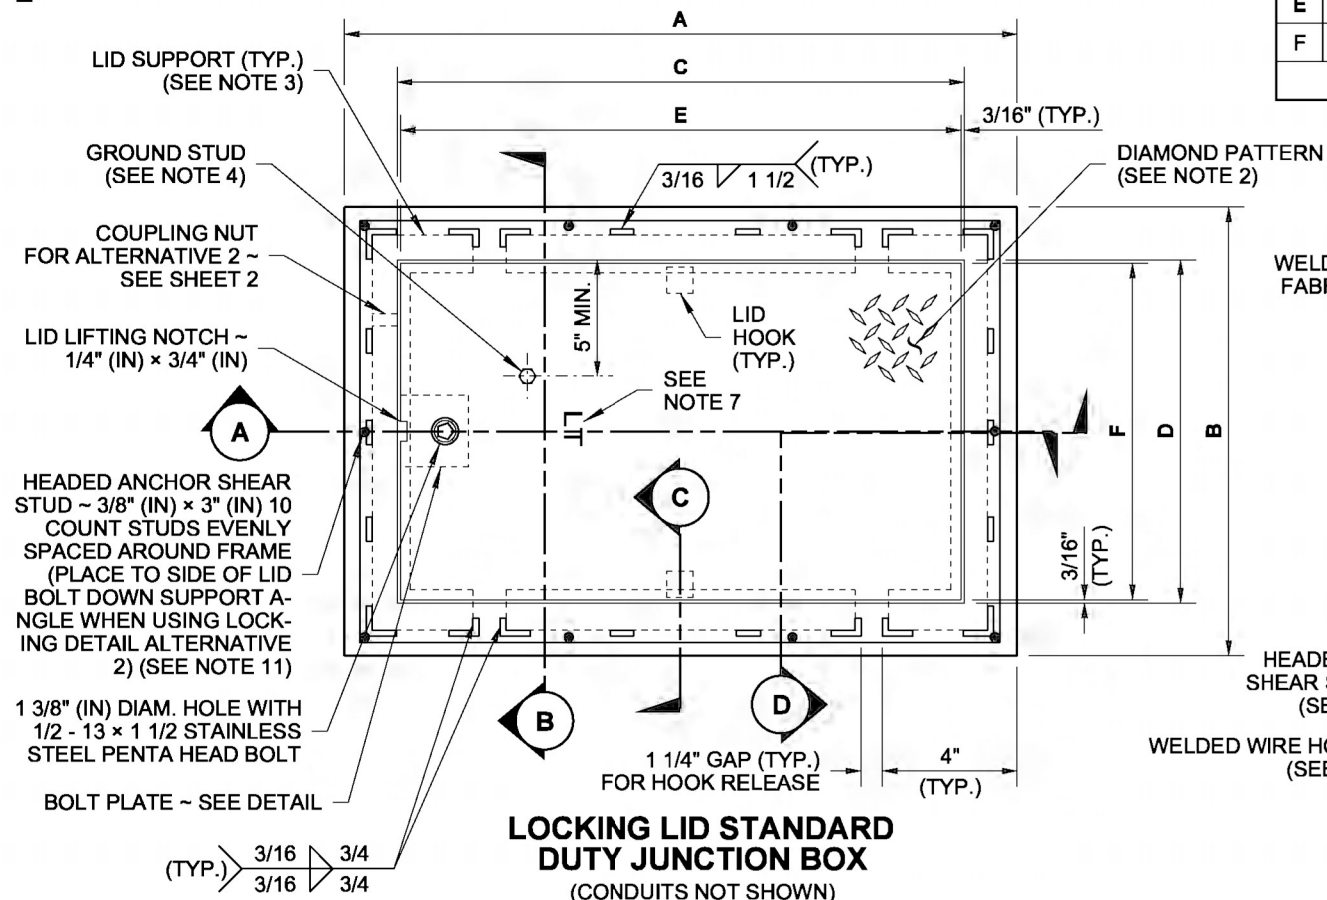


- ① Equipment Grounding Conductor
- ② Copper Solderless Crimp Connector 3/4" COVER
- ③ Equipment Bonding Jumper (See Note 6)
- ④ See Contract for conduit size and number

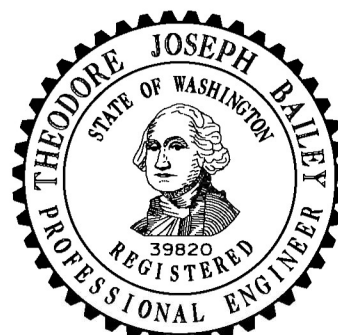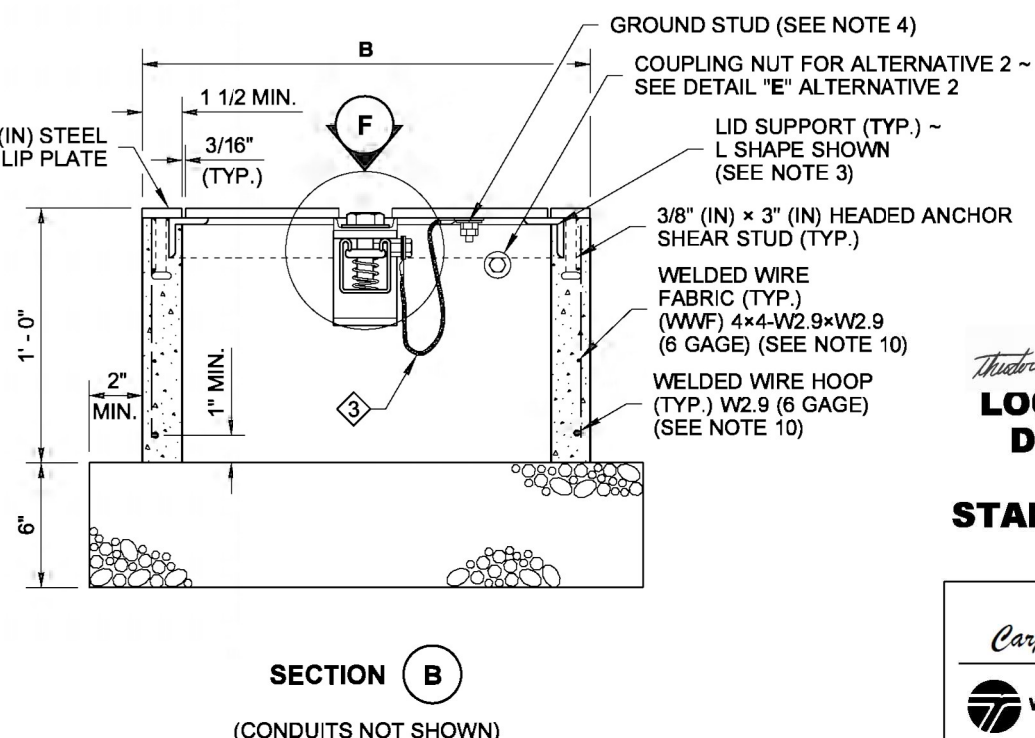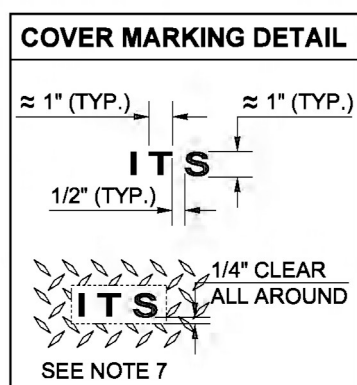


Thurston Joseph Bailey
Bailey, Ted
Apr 25 2016 9:32 AM
cosign

**LOCKING LID STANDARD
DUTY JUNCTION BOX
TYPES 1 & 2
STANDARD PLAN J-40.10-04**


SHEET 1 OF 2 SHEETS	
APPROVED FOR PUBLICATION	
<i>Carpenter, Jeff</i>	Carpenter, Jeff Apr 28 2016 3:12 PM
STATE DESIGN ENGINEER	
	Washington State Department of Transportation

DRAWN BY: LISA CYFORD

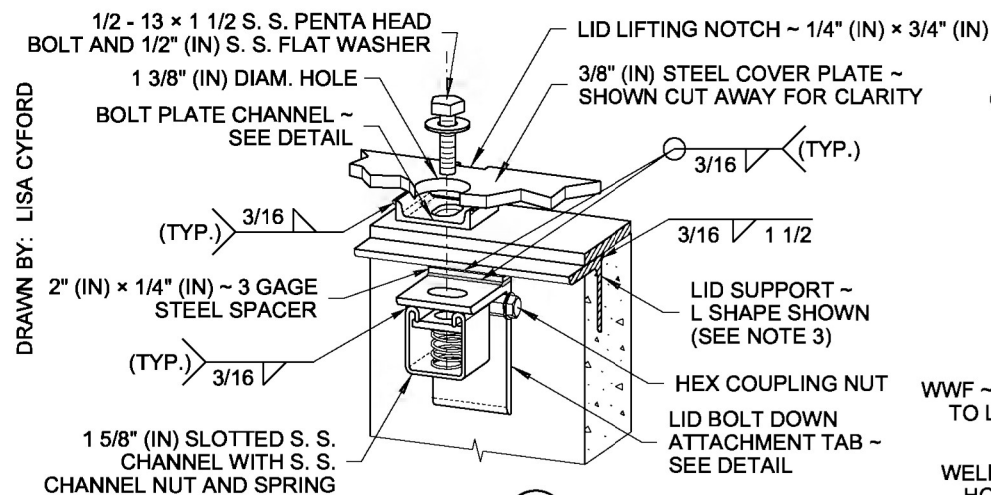


DETAIL F

ALTERNATIVE 1 SHOWN
PERSPECTIVE VIEW

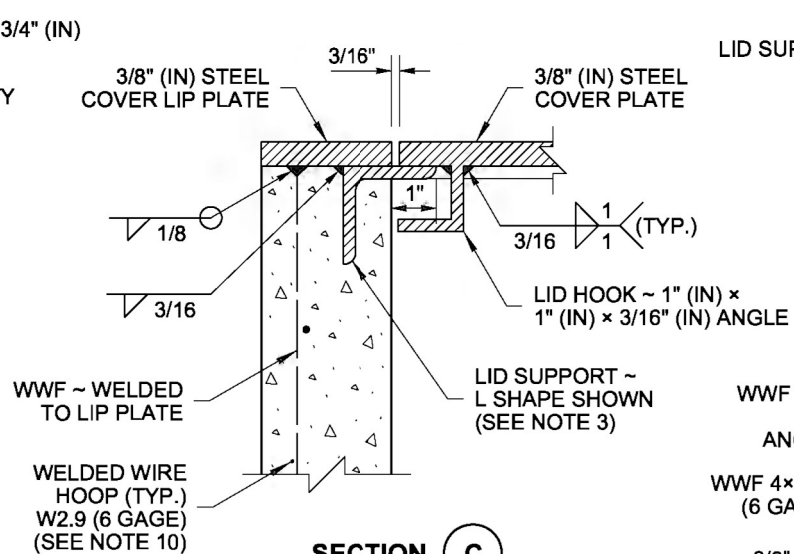


SECTION C

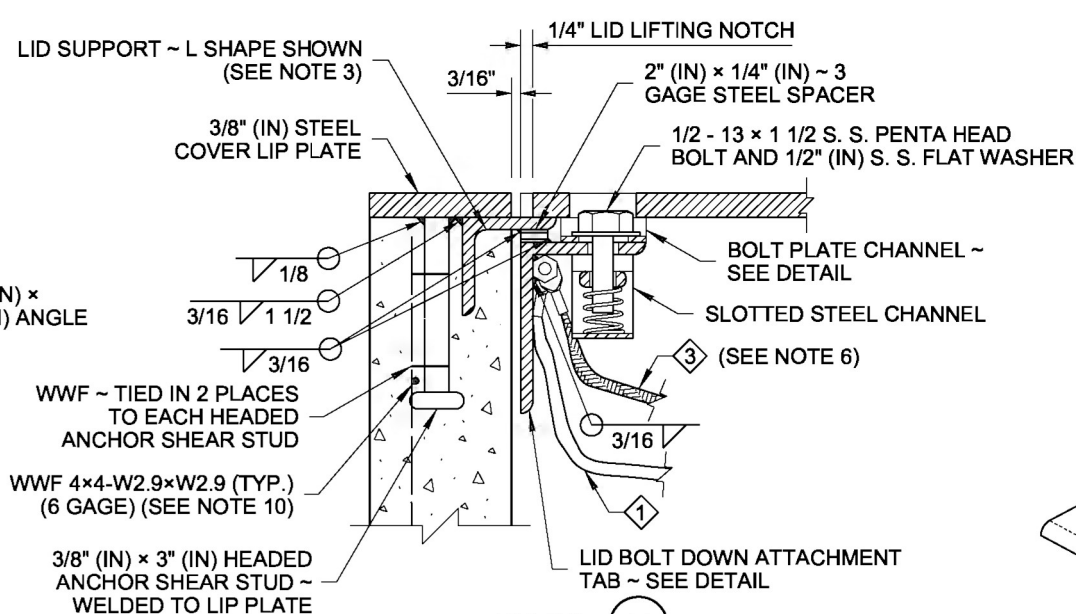


DETAIL E

ALTERNATIVE 1 SHOWN

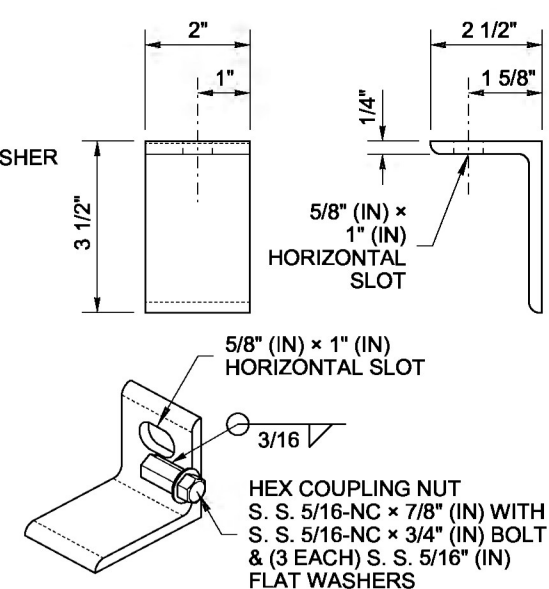


ALTERNATIVE 1
LID BOLT DOWN ATTACHMENT TAB
(SEE NOTE 12)

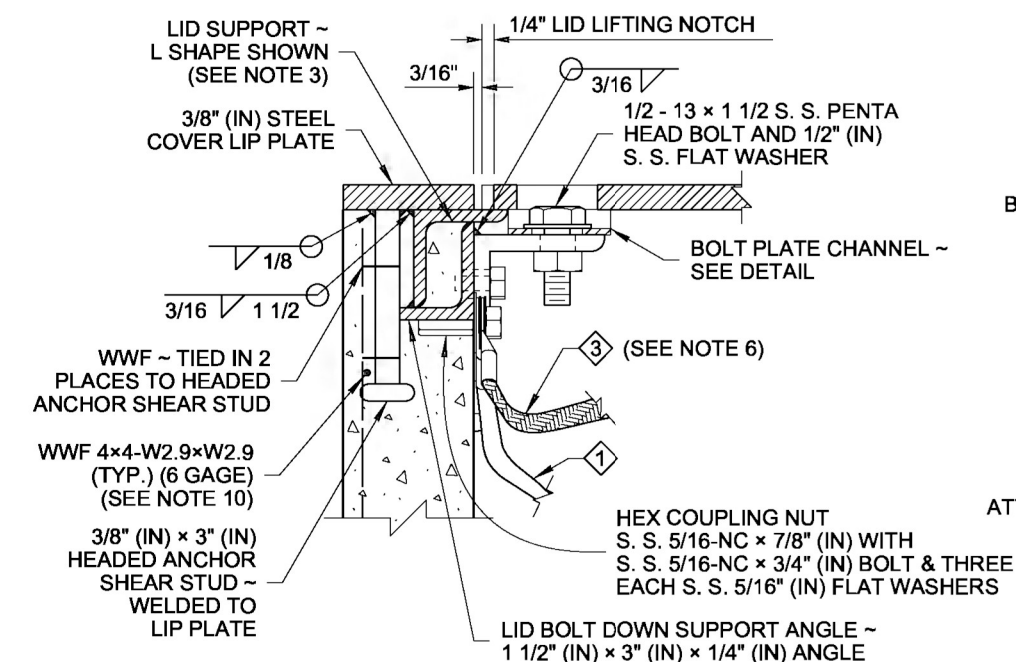


DETAIL E

ALTERNATIVE 2 SHOWN

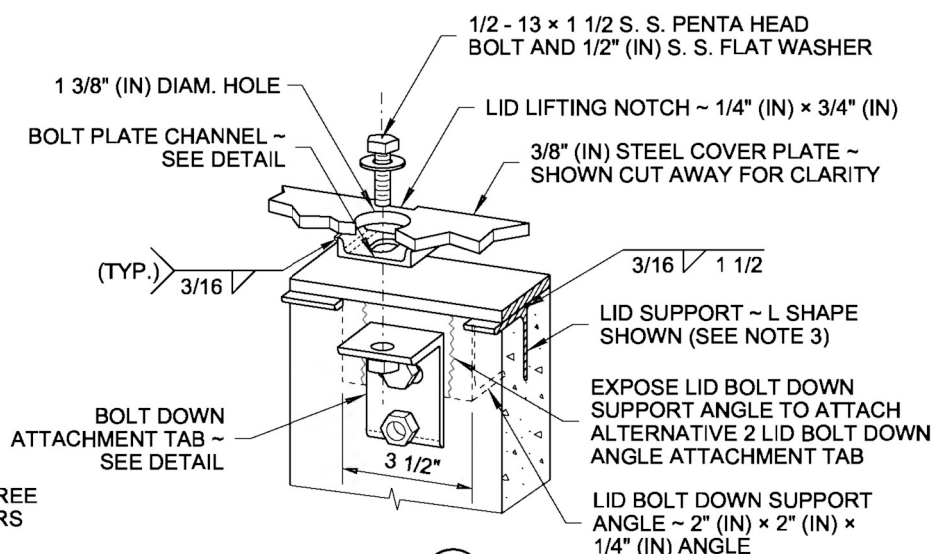


DETAIL F


ALTERNATIVE 2 SHOWN
PERSPECTIVE VIEW

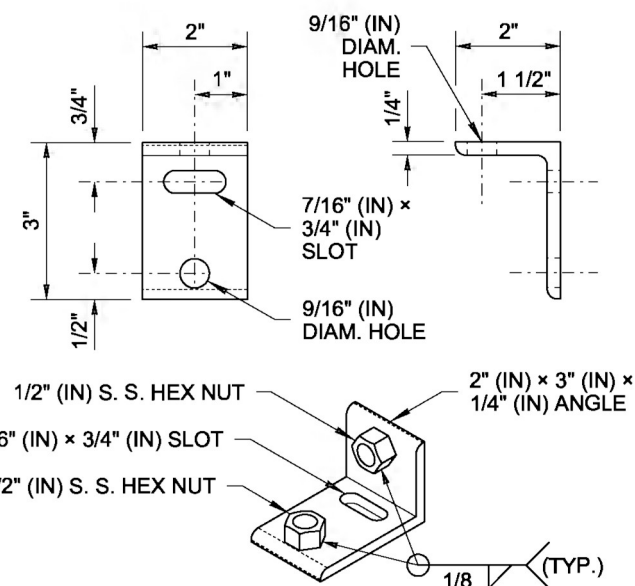

ALTERNATIVE 2
LID BOLT DOWN ATTACHMENT TAB
(SEE NOTE 12)

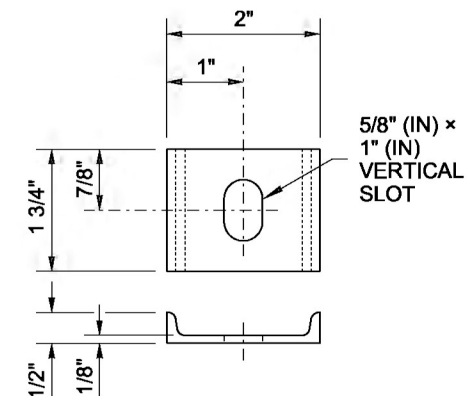


BOLT PLATE CHANNEL

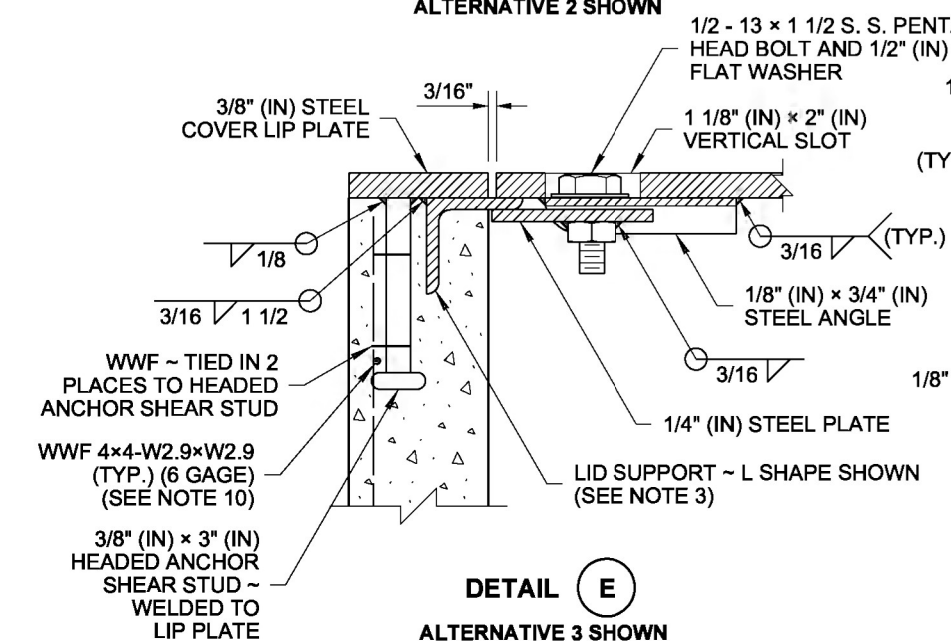


DETAIL E

ALTERNATIVE 3 SHOWN

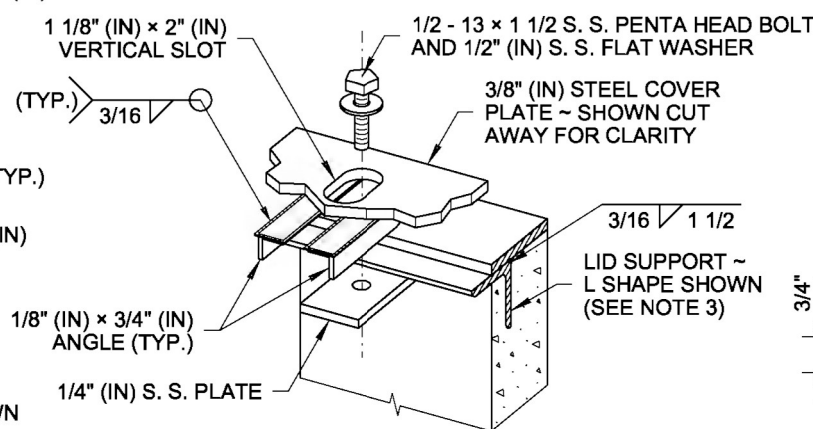

DETAIL F

ALTERNATIVE 3 SHOWN
PERSPECTIVE VIEW

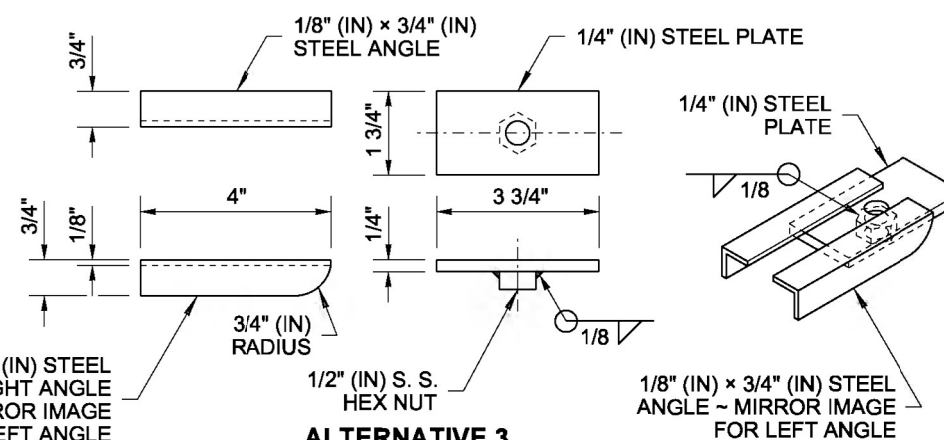

ALTERNATIVE 3
LID BOLT DOWN ATTACHMENT TAB
(SEE NOTE 12)



THEODORE JOSEPH BAILEY
STATE OF WASHINGTON
REGISTERED ENGINEER
39820
Bailey, Ted
Apr 25 2016 9:33 AM
**LOCKING LID STANDARD
DUTY JUNCTION BOX
TYPES 1 & 2
STANDARD PLAN J-40.10-04**

SHEET 2 OF 2 SHEETS

APPROVED FOR PUBLICATION

Carpenter, Jeff
Apr 28 2016 3:12 PM
STATE DESIGN ENGINEER
Washington State Department of Transportation